US009638433B2

(12) **United States Patent**
Norrell et al.

(10) **Patent No.: US 9,638,433 B2**
(45) **Date of Patent: May 2, 2017**

(54) **SYSTEM AND METHOD FOR MANAGING HVAC EXCESS AIR CONDITION**

(71) Applicant: **Trane International Inc.**, Piscataway, NJ (US)

(72) Inventors: **Billy W. Norrell**, Tyler, TX (US); **Gregory S. Brown**, Flint, TX (US); **John Tanner Taylor**, Flint, TX (US)

(73) Assignee: **Trane International Inc.**, Piscataway, NJ (US)

(*) Notice: Subject to any disclaimer, the term of this patent is extended or adjusted under 35 U.S.C. 154(b) by 539 days.

(21) Appl. No.: **13/630,579**

(22) Filed: **Sep. 28, 2012**

(65) **Prior Publication Data**

US 2014/0090408 A1 Apr. 3, 2014

(51) **Int. Cl.**
F25D 17/04 (2006.01)
F24F 11/00 (2006.01)

(52) **U.S. Cl.**
CPC ***F24F 11/0012*** (2013.01); ***F24F 11/0076*** (2013.01)

(58) **Field of Classification Search**
CPC F24F 11/0012; F24F 11/0076
USPC 62/186
See application file for complete search history.

(56) **References Cited**

U.S. PATENT DOCUMENTS

5,161,608	A	11/1992	Osheroff	
5,179,524	A *	1/1993	Parker et al.	700/277
5,305,953	A	4/1994	Rayburn et al.	
6,298,912	B1	10/2001	Rayburn et al.	
6,634,422	B2	10/2003	Rayburn et al.	
6,997,390	B2	2/2006	Alles	
7,062,830	B2	6/2006	Alles	
2005/0156050	A1*	7/2005	Shah et al.	236/1 B
2005/0178433	A1*	8/2005	Zelczer et al.	137/115.23
2009/0076658	A1*	3/2009	Kinnis	F24F 11/0001 700/277
2010/0307733	A1*	12/2010	Karamanos et al.	165/254
2010/0320277	A1*	12/2010	Stark	236/1 B

* cited by examiner

Primary Examiner — Larry Furdge
(74) *Attorney, Agent, or Firm* — Conley Rose, P.C.; J. Robert Brown, Jr.; Michael J. Schofield

(57) **ABSTRACT**

A heating, ventilation, and/or air conditioning (HVAC) system includes a bypass duct configured to selectively receive a bypass airflow therethrough in response to a supply air pressure of the HVAC system and a supply air temperature of the HVAC system.
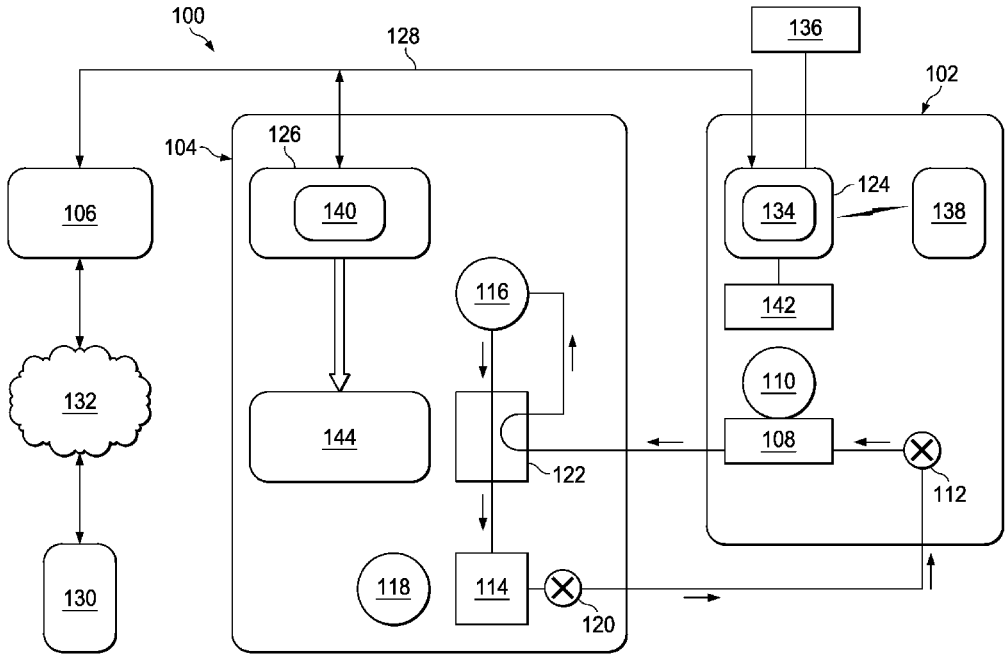
15 Claims, 5 Drawing Sheets