FIG. 10

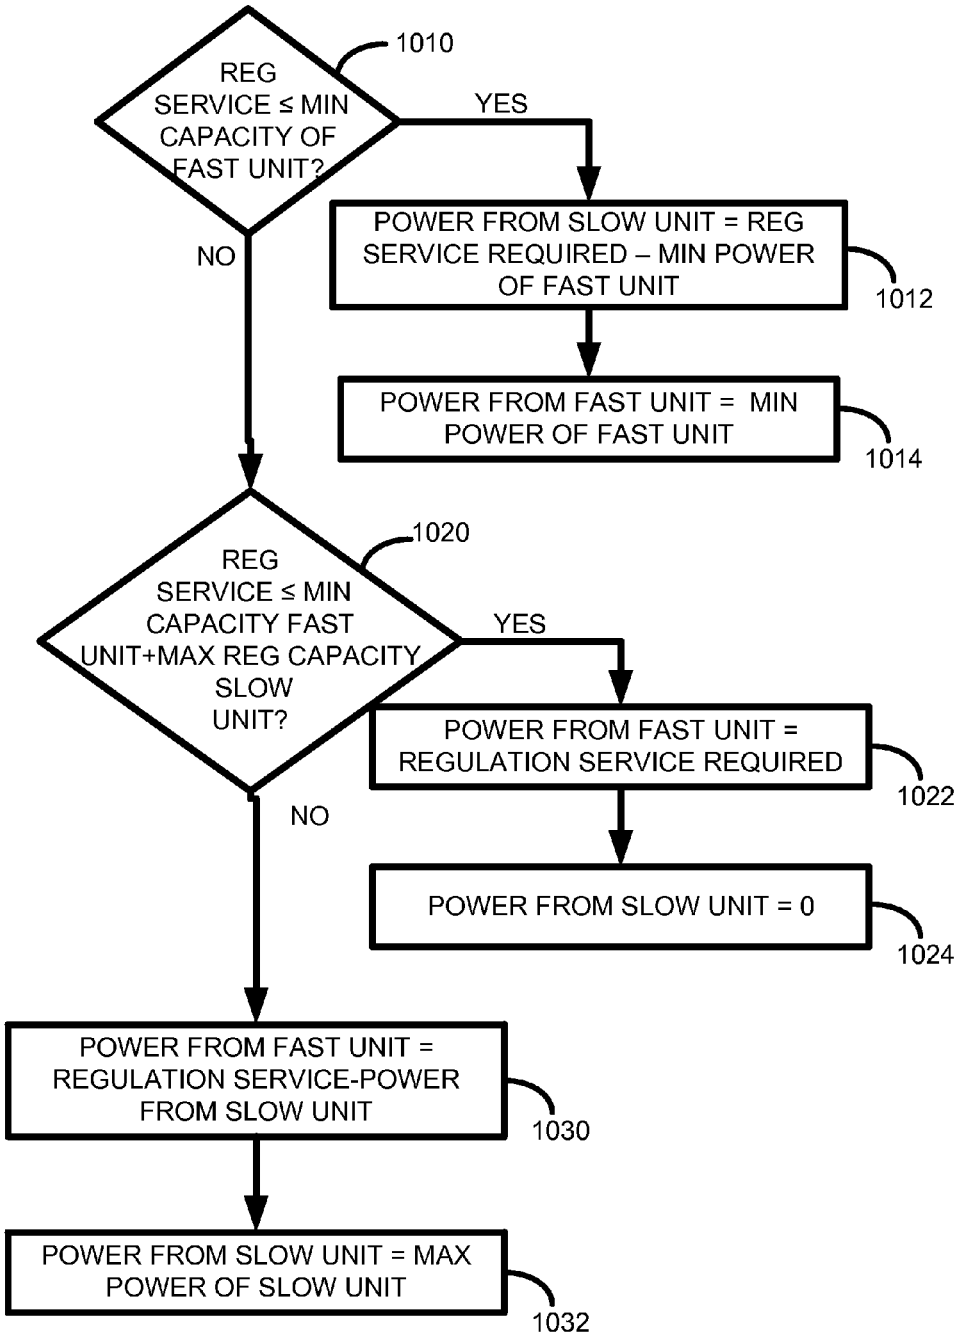
1010
REG SERVICE ≤ MIN CAPACITY OF FAST UNIT?
YES
NO
POWER FROM SLOW UNIT = REG SERVICE REQUIRED – MIN POWER OF FAST UNIT
1012
POWER FROM FAST UNIT = MIN POWER OF FAST UNIT
1014
1020
REG SERVICE ≤ MIN CAPACITY FAST UNIT+MAX REG CAPACITY SLOW UNIT?
YES
NO
POWER FROM FAST UNIT = REGULATION SERVICE REQUIRED
1022
POWER FROM SLOW UNIT = 0
1024
POWER FROM FAST UNIT = REGULATION SERVICE-POWER FROM SLOW UNIT
1030
POWER FROM SLOW UNIT = MAX POWER OF SLOW UNIT
1032